



—
your partner
in sensor
technology.



Datasheet EE300Ex-M1

Humidity and Temperature Sensor
for Intrinsically Safe Applications



EE300Ex-M1

Humidity and Temperature Sensor for Intrinsically Safe Applications

The EE300Ex intrinsically safe sensor reliably measures relative humidity (RH) and temperature (T) in explosion hazard areas. It complies with the classifications for Europe (ATEX), International (IECEX), China (NEPSI), USA/Canada (FM) and Korea (KCs) for flammable gas and dust applications. The EE300Ex it is also certified for gas applications according Japan (TIIS) certifications.

The entire device can be placed in the explosion endangered area. The remote sensing probe allows for classification up to T6.

Measurement Performance

The well proven E+E humidity sensors and competence in calibration allow for highly accurate and long term stable measurement over the full range of 0...100 %RH and -40...+180 °C (-40...+356 °F), with pressure rating up to 20 bar (300 psi). Besides the RH and T measurement, the EE300Ex calculates all humidity related parameters such as dew point temperature (Td), frost point temperature (Tf), absolute humidity (dv) or mixing ratio (r).

Moisture in Oil Measurement

The EE300Ex with ATEX, IECEX, NEPSI and KCs approval is suitable also for measuring water content (x) in ppm and water activity (aw) in isolation, lubrication and hydraulic oils. Typical applications include oil purifiers and online monitoring of lubrication and hydraulic oils.

Supply and Outputs

The device can be powered by an intrinsically safe supply unit or via Zener barriers. The measured or calculated data is available on two 4 - 20 mA, 2-wire outputs and on the LC display.

Robust, Functional Design

The stainless steel enclosure and sensing probe are suitable for harsh environment in challenging industrial applications. The EE300Ex design facilitates the installation as well as the replacement of the measuring section (electronics and probe) without time consuming wiring.

Easy Configuration and Adjustment

The setup of the analogue outputs as well as the adjustment of the RH and T reading can be easily performed with the optional EE-PCA Product Configuration Adapter and the free PCS10 Product Configuration Software.



EE300Ex-M1 wall mount without display



EE300Ex-M1 with display and remote probe


Features

Measurement performance

- Highest RH/T accuracy
- Working ranges:
-40 to +180 °C (-40...+356 °F),
up to 20 bar (300 psi)
- Calculation of all RH related physical quantities

Classifications

- Europe (ATEX)
- International (IECEX)
- China (NEPSI)
- USA / Canada (FM)
- Korea (KCs)
- Japan (TIIS) (for gas applications)

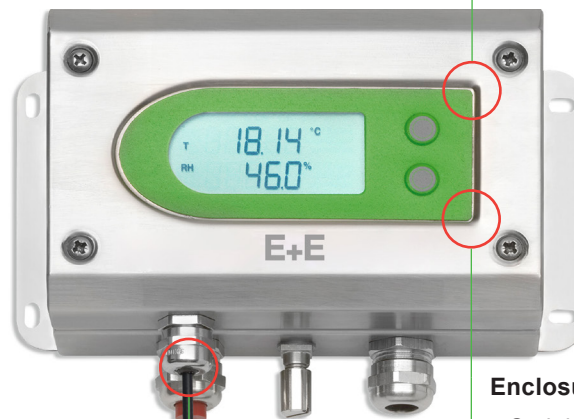

Outputs and Configuration

- 2 freely scalable analogue
4 - 20 mA, 2-wire outputs
- Supply with intrinsically safe supply unit
or via Zener barriers
- Full configuration and adjustment
using free PCS10 Software

Enclosure

- Stainless steel
- IP65/NEMA 4 protection rating
- Robust design
- Easy mounting and cleaning
- Versatile connection options
- Optional LC Display



Remote Probe

- Rugged construction
- Protective coating for sensing elements
- Outstanding long term stability
- Various probe and cable lengths
- Wide choice of filter caps

Inspection certificate

According to DIN EN 10204-3.1

Features

Protective Sensor Coating

The E+E proprietary sensor coating is a protective layer applied to the sensing elements, their leads and soldering points. The coating substantially extends sensor lifetime and ensures optimal measurement performance in corrosive environment (salts, off-shore applications). Additionally, it improves the long term stability in dusty, dirty or oily applications by preventing stray impedance caused by deposits on the active sensor surface or on the electrical connections.

Types

Type		Pressure Range	Working Range	Probe Ø
T1	Wall mount		-40...+60 °C (-40...+140 °F)	12 mm (0.47")
T7	Remote probe with cut-in fitting, pressure tight	0.01...20 bar (0.15...300 psi)	-40...+180 °C (-40...+356 °F)	12 mm (0.47")
T10	Remote probe with sliding fitting for assembly/disassembly under pressure, pressure tight	0.01...20 bar (0.15...300 psi)	-40...+180 °C (-40...+356 °F)	13 mm (0.51")

Accredited Traceable Calibration Certificate



Internationally recognised certificates for the calibration of measuring instruments from accredited laboratories document the traceability of the measurements to the International System of Units (SI). The E+E Elektronik calibration laboratory offers two levels of traceable calibrations.

- As a Designated Institute (DI) of the Republic of Austria, the E+E calibration laboratory maintains Austria's national measurement standards for humidity, dew point temperature, air velocity and CO₂. This authorises the E+E calibration laboratory to issue calibration certificates at the level of a National Metrological Institute (NMI).
- The E+E calibration laboratory is accredited by Akkreditierung Austria in accordance with DIN EN ISO/IEC 17025 with the identification number 0608. This allows the laboratory to issue ISO 17025 certificates for the measurands humidity, temperature, dew point temperature, air velocity, flow, pressure and CO₂.

Visit www.eplusecal.com for detailed information on calibration and to enquire a certificate of accredited traceable calibration for the EE300Ex from the Designated Institute.

ISO 9001 Calibration Certificate

An ISO 9001 calibration certificate documents the comparative measurement of a device against high quality reference equipment (factory level standard). The comparison is performed in accordance with internal procedures that comply with ISO 9001 and provides information on the specimen's measuring accuracy. The reference equipment is traceable to national standards, however, the calibration process is not accredited. Therefore, an ISO 9001 calibration is neither traceable nor internationally comparable.


Visit www.epluse.com for detailed information on calibration and to enquire an ISO 9001 calibration certificate.

Dimensions

Values in mm (inch)


Enclosure

Types: T1/T7/T10

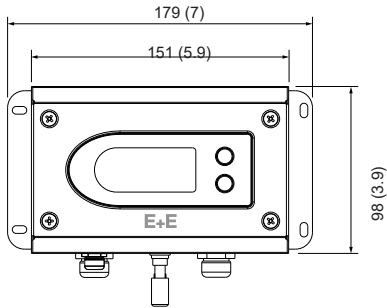


Type

T1: Wall mount

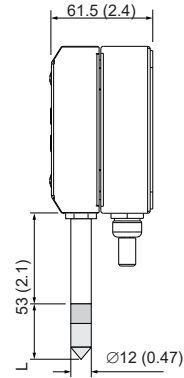


Type

T7: Remote probe 20 bar (300 psi)

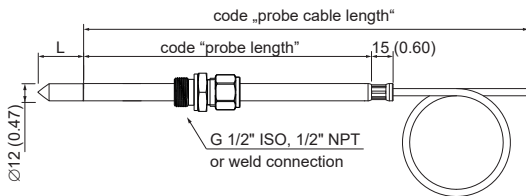

Type

T10: Remote probe 20 bar (300 psi) with sliding fitting for assembly/disassembly under pressure

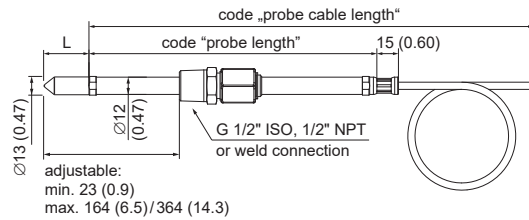

adjustable:
min. 23 (0.9)
max. 164 (6.5)/364 (14.3)

L - filter length	mm (inch)
Stainless steel sintered filter	33 (1.3)
PTFE filter, H ₂ O ₂ filter	33 (1.3)
Stainless steel grid filter	39 (1.5)
Oil filter	32 (1.26)

Technical Data

Measurands

Relative Humidity (RH)

Measuring range	0...100 %RH	
Accuracy¹⁾ incl. hysteresis, non-linearity and repeatability	$\pm(0.95 + 0.0013 * mv) \%RH$ $\pm 1.8 \%RH$ $\pm(1.05 + 0.0084 * mv) \%RH$ $\pm(1.15 + 0.013 * mv) \%RH$	
	mv = measured value	
Factory calibration uncertainty²⁾	0...90 %RH 90...100 %RH	$\pm(0.7 + 0.003 * mv) \%RH$ $\pm 1 \%RH$
	mv = measured value	
Temperature dependency of electronics, typ.	0.03 %RH/°C (0.017 %RH/°F)	
Response time t₉₀ with stainless steel filter at 20 °C (68 °F)	<30 s	

1) Defined against E+E calibration reference.

2) Defined at 23 °C with a coverage factor factor k=2, corresponding to a confidence level of 95 %.

Temperature (T)

Measuring range¹⁾	Wall mount Remote probe	-40...+60 °C (-40...+140 °F) -40...+180 °C (-40...+356 °F)
Accuracy²⁾		$\pm \Delta T [^{\circ}C]$
Factory calibration uncertainty³⁾ @23 °C (73 °F)		$\pm 0.1 ^{\circ}C$
Temperature dependency of electronics, typ.		$\pm 0.005 ^{\circ}C / ^{\circ}C$

1) For TIIS (Japan): models T1, T7, T10: -40...+60 °C (-40...+140 °F).

2) Defined against E+E calibration reference. For model T1, the accuracy data is valid only for air speed higher than 0.2 m/s.

3) Defined at 23 °C with an coverage factor of k=2, corresponding to a confidence level of 95 %.

Calculated Quantities

		from		up to				unit	
				Wall Mount		Remote Probe			
Dew point temperature	Td	-40	(-40)	60	(140)	100	(212)	°C	(°F)
Frost point temperature	Tf	-40	(-40)	60	(140)	100	(212)	°C	(°F)
Wet bulb temperature	Tw	-10	(14)	60	(140)	100	(212)	°C	(°F)
Water vapour partial pressure	e	0	(0)	200	(3)	1 100	(15)	mbar	(psi)
Mixing ratio	r	0	(0)	425	(2900)	999	(9999)	g/kg	(gr/lb)
Absolute humidity	dv	0	(0)	150	(60)	700	(300)	g/m ³	(gr/ft ³)
Specific enthalpy	h	0	(0)	400	(150 000)	2 800	(999 999)	kJ/kg	(BTU/lb)
Water activity	aw	0		-		1		1	
Water content	x	0		-		100 000		ppm	

Technical Data


Outputs

Analogue

Two analogue outputs freely selectable and scalable	2x 4 - 20 mA (2-wire) galvanically isolated Output 1 (CH1) must be connected!	$R_L (V_{CC}-9V) / 20 \text{ mA}$	$R_L = \text{load resistance}$
Accuracy @ 23 °C (68 °F)	±0.06 %FS		FS = full scale (20 mA)
Temperature dependency¹⁾	±0.008 %FS/°C (±0.0044 %FS/°F)		FS = full scale (20 mA)

1) Deviating from 23 °C (68 °F), defined at 12 mA.

General

Supply Voltage	$V_{CC \text{ min}} = (9+R_L \cdot 0.02) \text{ V DC}$	$V_{CC \text{ max}} = 28 \text{ V DC}$	$R_L = \text{load resistance}$
Current consumption, max.	20 mA per channel		
Electrical connection	Screw terminals max. 1.5 mm ² (AWG 16)		
Cable glands	M16 M20	Cable Ø5...10 mm (0.2...0.4") Cable Ø10...14 mm (0.4...0.6")	
Pressure range for pressure-tight probe	0.01...20 bar (0.15...300 psi)		
Working temperature range	Probe Electronics without display Electronics with display	According to measuring range -40...+60 °C (-40...+140 °F) -20...+60 °C (-4...+140 °F)	
Storage temperature range	Electronics and probe	-20...+60 °C (-4...+140 °F)	
Material	Enclosure Probe without Filter Probe cable	Stainless steel 1.4404 Stainless steel 1.4404 PFA (Perfluoralkoxy)	
Protection rating	Enclosure	IP65/NEMA 4	
Electromagnetic compatibility	EN 61326-1 FCC Part15 Class B	EN 61326-2-3 ICES-003 Class B	Industrial Environment
Conformity			

Ex - Classifications

Europe (ATEX with order code "EX1")

Certificate	TPS 13 ATEX 38892 003 X by TÜV SÜD Product Service GmbH
Safety factors	Ui = 28 V; li = 100 mA; Pi = 700 mW; Ci = 2.2 nF; Li ≈ 0 mH
Ex-Designation Transmitter without display Transmitter with display Remote probe	II 1 G Ex ia IIC T4 Ga / II 1 D Ex ia IIIC T ₂₀₀ 80°C Da II 2 G Ex ia IIC T4 Gb / II 1 G Ex ia IIB T4 Ga II 1 G Ex ia IIC T6...T1 Ga / II 1 D Ex ia IIIC T ₂₀₀ 80°C...220°C Da

International (IECEx with order code "EX2")

Certificate	IECEx FMG 14.0017 X by FM Approvals
Safety factors	6.4 Vdc ≤ Ui ≤ 28 Vdc; li = 100 mA; Pi = 700 mW; Ci = 2.2 nF; Li = 0 mH
Ex-Designation Transmitter without display Transmitter with display Remote probe	Ex ia IIC T4 Ta = -40°C to 60°C Ga / Ex ia IIIC T131°C Da Ex ia IIC T4 Ta = -40°C to 60°C Gb / Ex ia IIB T4 Ta = -40°C to 60°C Ga Ex ia IIC T6-T1 Ta = -70°C to 200°C Ga / Ex ia IIIC T80°C Da

China (NEPSI with order code "EX4")

Certificate	Cert NO. GYJ16.1417X by NEPSI
Safety factors	Ui = 28 Vdc; li = 100 mA; Pi = 700 mW; Ci = 2.2 nF; Li = 0 mH
Ex-Designation Transmitter without display Transmitter with display Remote probe	Ex ia IIC T4 Ga, Ex iaD 20 T131 Ex ia IIC T4 Gb, Ex ia IIB T4 Ga Ex ia IIC T1~T6 Ga, Ex iaD 20 T80

Korea (KCs with order code "EX5")

Certificate gas Remote probe Transmitter without display Transmitter with display	20-AV4BO-0253X 20-AV4BO-0254X 20-AV4BO-0257X (EPL Ga - Zone 0) 20-AV4BO-0258X (EPL Gb - Zone 1)
Certificate dust Remote probe Transmitter without display	20-AV4BO-0256X 20-AV4BO-0255X
Safety factors	6.4 V DC ≤ Ui ≤ 28 V DC; li = 100 mA; Pi = 700 mW; Ci = 2.2 nF; Li = 0 mH
Ex-Designation Transmitter without display Transmitter with display Remote probe	Ex ia IIC T4 -40°C ≤ Tamb ≤ +60°C Ex iaD 20 IP6X T131°C -40°C ≤ Tamb ≤ +60°C Ex ia IIC T4 -40°C ≤ Tamb ≤ +60°C (up to Zone 1) Ex ia IIB T4 -40°C ≤ Tamb ≤ +60°C (up to Zone 0) Ex ia IIC T6-T1 / Ex iaD 20 IP6X T80 °C -40°C ≤ Tamb ≤ +60°C

Japan (TIIS with order code "EX6")

Certificate	Nr. TC22061 by TIIS
Safety factors	Ui = 28 Vdc; li = 100 mA; Pi = 700 mW; Ci = 2.2 nF; Li = 0 mH Ta = -40 °C to +60 °C
Ex-Designation only for gas	Ex ia IIC T4 Gb

Ex - Classifications

USA (FM with order code “EX3”)

Certificate	No. FM17US0302X by FM Approvals
Safety factors	6.4 Vdc ≤ Vmax (or Ui) ≤ 28 Vdc; I _{max} (or I _i) = 100 mA; Pi = 700 mW; Ci = 2.2 nF; Li = 0 mH
Ex-Designation Equipment Group I: EE300Ex without display	Class I, II, III, Division 1, Groups A, B, C, D, E, F and G; T4 Ta = -40°C to +60°C; Entity – M1_139080; IP65 Class I, II, III, Division 2, Groups A, B, C, D, E, F and G; T4 Ta = -40°C to +60°C Class I, Zone 0, AEx ia IIC T4 Ta = -40°C to +60°C Ga; Entity – M1_139080; IP65 Zone 20, AEx ia IIIC T131°C Ta = -40°C to +60°C Da; Entity – M1_139080; IP65
Remote probe	Class I, II, III, Division 1, Groups A, B, C, D, E, F and G; T6...T1; Entity – M1_139080; IP65 Class I, II, III, Division 2, Groups A, B, C, D, E, F and G; T6...T1 Class I, Zone 0, AEx ia IIC T6...T1 Ga; Entity – M1_139080; IP65 Zone 20, AEx ia IIIC T80°C Da; Entity – M1_139080; IP65
Equipment Group II: EE300Ex with display	Class I, Division 1, Groups C and D; T4 Ta = -40°C to +60°C; Entity – M1_139080 Class I, Division 2, Groups A, B, C and D; T4 Ta = -40°C to +60°C; Entity – M1_139080 Class I, Zone 0, AEx ia IIB T4 Ta = -40°C to +60°C Ga; Entity – M1_139080 Class I, Zone 1, AEx ia IIC T4°C Ta = -40°C to +60°C Gb; Entity – M1_139080
Remote probe	Class I, II, III, Division 1, Groups A, B, C, D, E, F and G; T6...T1; Entity – M1_139080; IP65 Class I, II, III, Division 2, Groups A, B, C, D, E, F and G; T6...T1 Class I, Zone 0, AEx ia IIC T6...T1 Ga; Entity – M1_139080; IP65 Zone 20, AEx ia IIIC T80°C Da; Entity – M1_139080; IP65

CANADA (FM with order code “EX9”)

Certificate	No. FM17CA0154X by FM Approvals
Safety factors	6.4 Vdc ≤ Vmax (or Ui) ≤ 28 Vdc; I _{max} (or I _i) = 100 mA; Pi = 700 mW; Ci = 2.2 nF; Li = 0 mH
Ex-Designation Equipment Group I: EE300Ex without display	Class I, II, III, Division 1, Groups A, B, C, D, E, F and G; T4 Ta = -40°C to +60°C; Entity – M1_139080; IP65 Class I, II, III, Division 2, Groups A, B, C, D, E, F and G; T4 Ta = -40°C to +60°C Zone 0, Ex ia IIC T4 Ta = -40°C to +60°C Ga; Entity – M1_139080; IP65 Zone 20, Ex ia IIIC T131°C Ta = -40°C to +60°C Da; Entity – M1_139080; IP65
Remote Probe	Class I, II, III, Division 1, Groups A, B, C, D, E, F and G; T6...T1; Entity – M1_139080; IP65 Class I, II, III, Division 2, Groups A, B, C, D, E, F and G; T6...T1 Zone 0, Ex ia IIC T6...T1 Ga; Entity – M1_139080; IP65 Zone 20, Ex ia IIIC T80°C Da; Entity – M1_139080; IP65
Equipment Group II: EE300Ex with display	Class I, Division 1, Groups C and D; T4 Ta = -40°C to +60°C; Entity – M1_139080 Class I, Division 2, Groups A, B, C and D; T4 Ta = -40°C to +60°C; Entity – M1_139080 Zone 0, Ex ia IIB T4 Ta = -40°C to +60°C Ga; Entity – M1_139080 Zone 1, Ex ia IIB T4 Ta = -40°C to +60°C Gb; Entity – M1_139080
Remote Probe	Class I, II, III, Division 1, Groups A, B, C, D, E, F and G; T6...T1; Entity – M1_139080; IP65 Class I, II, III, Division 2, Groups A, B, C, D, E, F and G; T6...T1 Zone 0, Ex ia IIC T6...T1 Ga; Entity – M1_139080; IP65 Zone 20, Ex ia IIIC T80°C Da; Entity – M1_139080; IP65

The USA and Canada approvals are valid for air and gas measurement only.

Ordering Guide

Feature	Description	Code			
		EE300Ex-M1A6HS2			
Type	Wall mount	T1			
	Remote probe for cut-in fitting, pressure-tight, 20 bar (300 psi)		T7		
	Remote probe for sliding fitting, pressure-tight, 20 bar (300 psi)			T10	
Display¹⁾	Without display		D0		
	Display		D1		
Electrical connection	2x M16 cable gland		E2		
	1/2" NPT conduit		E13		
	2x M20 cable gland		E15		
Probe cable length	Wall mount	K0			
	1 m (3.3 ft)		K1	K1	
	2 m (6.6 ft)		K2	K2	
	5 m (16.4 ft)		K5	K5	
	10 m (32.8 ft)		K10	K10	
Probe length	Wall mount, 50 mm (1.97")	L50			
	65 mm (2.56") ²⁾		L65		
	100 mm (3.95")		L100		
	200 mm (7.84")		L200	L200	
	400 mm (15.75")		L400	L400	
Process connection (Zone feed-through)	Without probe fitting	PA0	PA0		
	G1/2" ISO - cut-in fitting, Ø12 mm (0.47")		PA20		
	1/2" weld cut-in fitting, Ø12 mm (0.47")		PA21		
	1/2" NPT - cut-in fitting, Ø12 mm (0.47")		PA22		
	G1/2" ISO - sliding fitting, Ø13 mm (0.51")			PA23	
	1/2" NPT - sliding fitting, Ø13 mm (0.51")			PA25	
Filter	Stainless steel sintered	F4	F4	F4	
	PTFE (Polytetrafluoroethylene) ³⁾	F5	F5	F5	
	Stainless steel - metal grid (up to 180 °C / 356 °F)	F9	F9	F9	
	Catalytic for H ₂ O ₂ sterilisation ³⁾	F12	F12	F12	
	Stainless steel with boreholes Ø 3 mm (0.12")			F13	F13
Sensing element protection	Without coating			C0	C0
	E+E proprietary coating ⁴⁾	C1	C1	C1	
Ex-approval	ATEX (Europe)		EX1		
	IECEX (International)		EX2		
	FM (USA)		EX3		
	NEPSI (China)		EX4		
	KCs (Korea)		EX5		
	TIIS (Japan) ⁵⁾		EX6		
	FM (Canada)		EX9		
Analog.Outp.	Output 1 measurand⁶⁾	Measurand (<i>xx</i> see measurand code below) ⁷⁾	MAxx		
	Output 1 scaling low	Value	SALValue		
	Output 1 scaling high	Value	SAHValue		
	Output 2 measurand	Measurand (<i>xx</i> see measurand code below) ⁷⁾	MBxx		
	Output 2 scaling low	Value	SBLValue		
	Output 2 scaling high	Value	SBHValue		
Accredited Traceable Calibration Certificate in accordance with DIN EN ISO/IEC 17025		see www.eplusecal.com			
ISO 9001 Calibration Certificate		see www.epluse.com			

- 1) No display possible for environments with EPL Ga IIC (EX1/EX2/EX3/EX9) / Gas Groups A, B for Division 1 (EX3/EX9) / Zone 0 IIC (EX5).
- 2) Allowed only in combination with PA0.
- 3) May not be used in EPL Ga IIC (EX1/EX2/EX3/EX9) / Gas Groups A, B for Division 1 (EX3/EX9) / Zone 0 IIC (EX5). For TIIS (Japan) approval not allowed in models T1, T7 and T10.
- 4) Not appropriate for moisture in oil measurement, obligatory for all other applications, free of charge.
- 5) Only gas Ex up to EPL Gb (Zone 1).
- 6) Assign the most relevant measurand to output 1.
- 7) For TIIS (Japan) approval, models T1, T7, and T10 have a maximum temperature working range of -40...+60 °C (-40...+140 °F).

Measurand Code

For Output 1 and 2 in the Ordering Guide

Measurand	Unit	Code
		MAxx / MBxx
Relative humidity	RH %	10
Temperature	T °C °F	1 2
Dew point temperature	Td °C °F	52 53
Frost point temperature	Tf °C °F	65 66
Mixing ratio	r g/kg gr/lb	60 61
Absolute humidity	dv g/m ³ gr/ft ³	56 57
Wet bulb temperature	Tw °C °F	54 55
Water vapour partial pressure	e mbar psi	50 51
Specific enthalpy	h kJ/kg BTU/lb	62 64
Water activity ¹⁾	aw 1	67
Water content in mineral transformer oil ¹⁾	x ppm	70
Water content in customer specific oil ¹⁾²⁾	x ppm	70PPMxxx

1) Not allowed for FM (USA / Canada) and TIIS (Japan) approval.
2) Procedure for customer specific oil: see table below.

Procedure for customer specific oil

Option	Description	Code
Oil number is known	Replace the <i>xxx</i> by the corresponding number	
Obtaining new oil parameters via oil analysis	Contact and provide E+E HQ the datasheet of the oil before sending us 2 litres of oil. After determination of the oil specific parameters, the corresponding oil number is available, insert this in place of the <i>xxx</i> .	Oil-ppmcal
Obtaining new oil parameters via saturation curve	Contact and provide E+E HQ the datasheet of the oil together with the saturation curve. After calculation of the oil specific parameters, the corresponding oil number is available, insert this in place of the <i>xxx</i> .	Oil-calc

i PLEASE NOTE

No mix of SI/US units allowed.

Order Examples

EE300Ex-M1A6HS2T7D1E2K10L200PA20F4C1EX1MA1SAL-40SAH180MB10SBL0SBH100

Feature	Code	Description
Type	T7	Remote probe for cut-in fitting, pressure tight, 20 bar (300 psi)
Display	D1	Display
Electrical connection	E2	2x M16 cable gland
Probe cable length	K10	10 m (32.8 ft)
Probe length	L200	200 mm (7.87")
Process connection (Zone feed-through)	PA20	G1/2" ISO - cut-in fitting, Ø12 mm (0.47")
Filter	F4	Stainless steel sintered
Sensing element protection	C1	E+E proprietary coating
Ex-approval	EX1	ATEX (Europe)
Output 1 measurand	MA1	Temperature T [°C]
Output 1 scaling low	SAL-40	-40
Output 1 scaling high	SAH180	180
Output 2 measurand	MB10	Relative humidity RH [%]
Output 2 scaling low	SBL0	0
Output 2 scaling high	SBH100	100

EE300Ex-M1A6HS2T1D0E2K0L50PA0F9C1EX3MA2SAL-40SAH140MB53SBL-40SBH140

Feature	Code	Description
Type	T1	Wall mount
Display	D0	Without display
Electrical connection	E2	2x M16 cable gland
Probe cable length	K0	Wall mount
Probe length	L50	Wall mount, 50 mm (1.97")
Process connection (Zone feed-through)	PA0	Without probe fitting
Filter	F9	Stainless steel - metal grid (up to 180 °C / 356 °F)
Sensing element protection	C1	E+E proprietary coating
Ex-approval	EX3	FM (USA)
Output 1 measurand	MA2	Temperature T [°F]
Output 1 scaling low	SAL-40	-40
Output 1 scaling high	SAH140	140
Output 2 measurand	MB53	Dew point temperature Td [°F]
Output 2 scaling low	SBL-40	-40
Output 2 scaling high	SBH140	140

Accessories

For further information see datasheet [Accessories](#).

Description	Code
Blind front cover for EE300Ex	HA011401
Safety barrier, 1-channel, STAHL 9002/13-280-093-001	HA011410
Intrinsically safe supply unit, 1-channel, STAHL 9160/13-11-11	HA011405
Intrinsically safe supply unit, 2-channel, STAHL 9160/23-11-11	HA011406
Sealing plug for unused M16 cable glands	HA011402
Sealing plug for unused M20 cable glands	HA011404
Ball valve with 1/2" ISO female thread, ATEX certified	HA011403
Intrinsically safe supply unit, 1-channel, PC MACX MCR-EX-SL-RPSSI-1 ²⁾	HA011411
Intrinsically safe supply unit, 2-channel, PC MACX MCR-EX-SL-RPSS-2I-2I ²⁾	HA011412
O-ring 13x1.5 mm (0.5"x 0.06") - FKM-60	HA050308
PCS10 Product Configuration Software (Free download: www.epluse.com/pcs10)	PCS10
Adapter Kit for configuration and adjustment (must be ordered together, see datasheet EE-PCA at www.epluse.com/ee-pca) Pos. 1: Product Configuration Adapter Pos. 2: Connection cable	EE-PCA HA011068

1) For use with Type T22
2) Only for ATEX and IECEx



Company Headquarters &
Production Site

E+E Elektronik Ges.m.b.H.
Langwiesen 7
4209 Engerwitzdorf | Austria
T +43 7235 605-0
F +43 7235 605-8
info@epluse.com
www.epluse.com

Subsidiaries

E+E Sensor Technology (Shanghai) Co., Ltd.
T +86 21 6117 6129
info@epluse.cn

E+E Elektronik France SARL
T +33 4 74 72 35 82
info.fr@epluse.com

E+E Elektronik Deutschland GmbH
T +49 6171 69411-0
info.de@epluse.com

E+E Elektronik India Private Limited
T +91 990 440 5400
info.in@epluse.com

E+E Elektronik Italia S.r.l.
T +39 02 2707 86 36
info.it@epluse.com

E+E Elektronik Korea Ltd.
T +82 31 732 6050
info.kr@epluse.com

E+E Elektronik Corporation
T +1 847 490 0520
info.us@epluse.com



—
your partner
in sensor
technology.